

EXPLANATION



Withdrawals are in million gallons per day (Mgal/d)

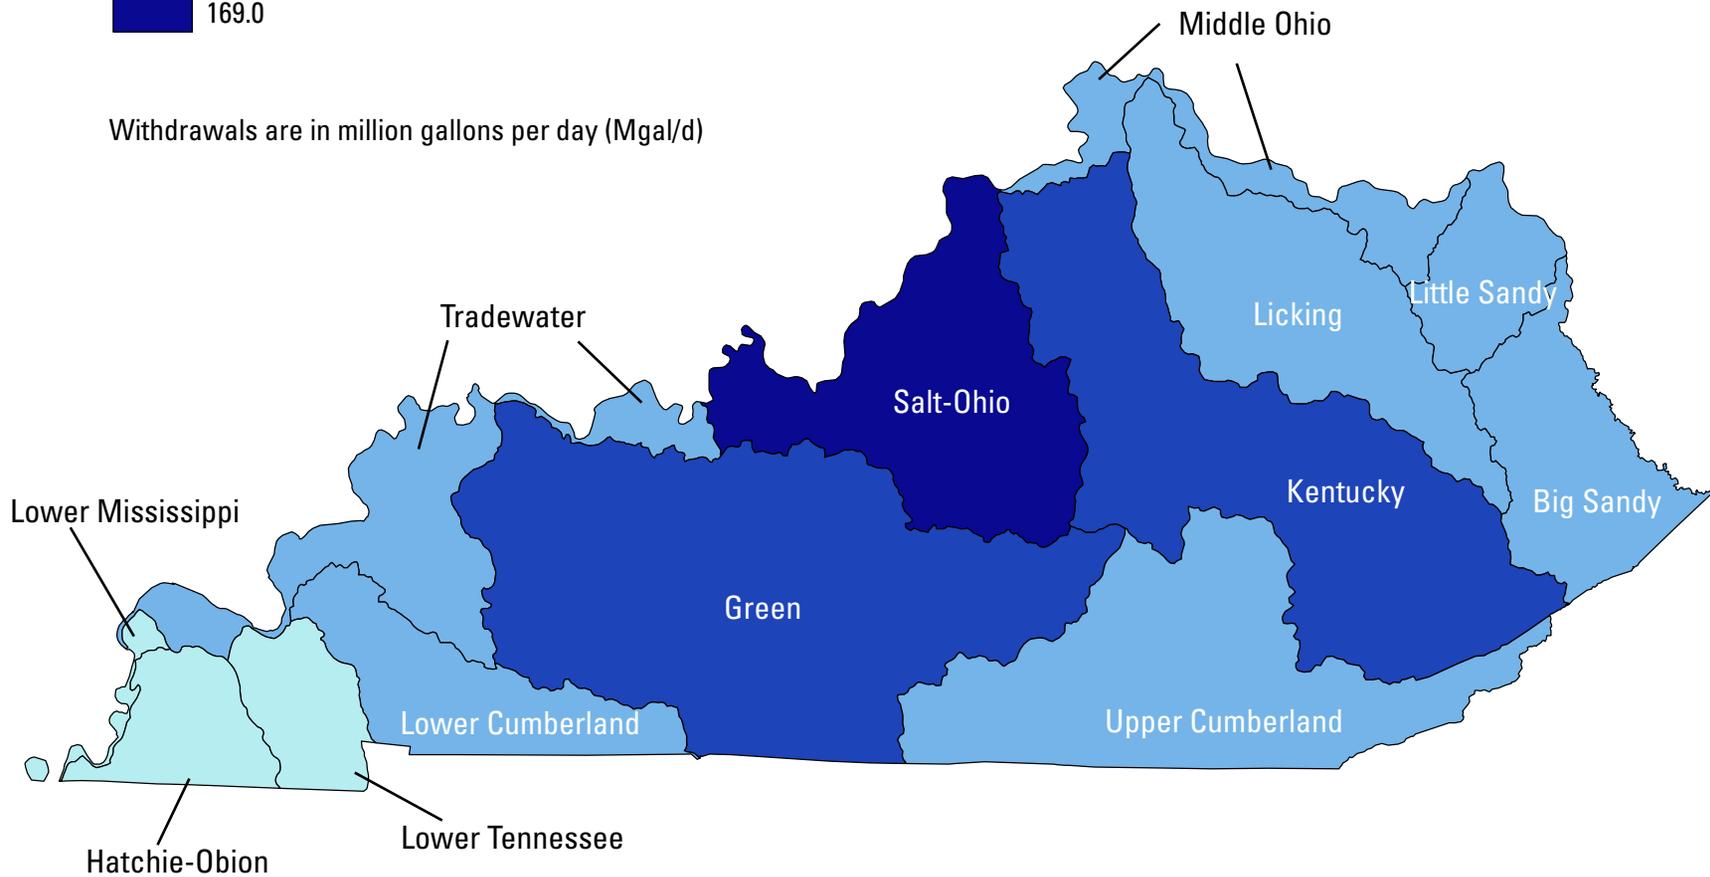


Figure 6. Average annual permitted public water-supply withdrawals, by watershed, in Kentucky, 2005.